



AC voltage meters 2



Direct DC current meters 3



Indirect AC current meters with changeable dial plate 4



Indirect DC current meters with changeable dial plate 5



Power meters 6




Frequency meters 7



Power factor (cos φ) meters 7



Operating time counters 8



TSF shunt product family 8



Analogue voltage meters 9



Analogue ampere-meters for indirect measurement, DC 9



Analogue frequency meters 10



Power factor meters 10



Digital measuring instruments 10



Analogue power meters 11



Direct digital ammeter 12



Digital power factor meter 14



Digital multimeter 15



Power analyzer 17



Direct energy meter 18



Energy meters, 1 phase 19



Power meter, windows type, 1 phase 19



Plug-in digital energy meter 20



Phase correctors 21



Low voltage current transformers 26



Calibrated current transformer 28



Digital multimeter 30



Digital clamp meter 32



Metal searching device 33



Infrared thermometer 33



Motor vehicle testing lamp 33



Voltage tester screwdriver 34



Voltage tester 34







Induction controlling instrument 34

Pictograms of the table head

U_n Rated voltage (V)	I_n Rated current (A)	P_{max} Max. power	P_s Starting power
Solid, strained, fine wire	Terminal capacity	Dimensions (L × W × H)	Weight
Meter with electromechanical display	Meter with LCD display	Display (number of digits)	Power supply
Turns ratio	Shunt	Type of battery, sender	Type of battery, receiver
Width of rail (CT)	Cable diameter (CT)	Direct meter	Meter with current transformer
Impulse output	Impulse width	Starting current	Base current (max. current)
Capacitor groups	Temperature measuring	Dimensions of frame	Measuring range
Accuracy class	Number of current transformers	Cutting size (mm)	

Pictograms of the technical data





Vibration resistance	Rated thermal current	Security factor	Auxiliary contacts
Certified current transformer	Relativ humidity	Impulse voltage withstand	Protection degree (installed, from the front side)
Rated dynamic current	Display of elapsed hour counter	Changeable scale	Self consumption
Rated insulation voltage	Continuous overload	Optical signal	Impulse output
Cam switch	Momentary overload	Linear scale	Not changeable scale
Continuous overload	AC voltage measuring	Low battery display	Polarity display
Momentary overload	Diode test	Battery test	Logarithmic scale
AC current measuring	Rated voltage (V)	Measuring of amplification factor of transistor	Seal-leadable
DC voltage measuring	Ambient temperature	Can be install on mounting rail	DC current measuring
Resistance measuring	Connectable cable	Storage temperature	Temperature measuring
Operation temperature	Protection of terminals (with protection cap)	Material: ABS	Flammability according to UL94
Protection degree	Impulse generator	Voltage detection without contact	

AC voltage meters

TRACON

ACVM96-30	96 × 96 mm	0-30 V	1,5 %	90 mm
ACVM96-120	96 × 96 mm	0-120 V	1,5 %	90 mm
ACVM96-250	96 × 96 mm	0-250 V	1,5 %	90 mm
ACVM96-450	96 × 96 mm	0-500 V	1,5 %	90 mm
ACVM96-600	96 × 96 mm	0-600 V	1,5 %	90 mm
ACVM72-30	72 × 72 mm	0-30 V	1,5 %	66 mm
ACVM72-120	72 × 72 mm	0-120 V	1,5 %	66 mm
ACVM72-250	72 × 72 mm	0-250 V	1,5 %	66 mm
ACVM72-450	72 × 72 mm	0-500 V	1,5 %	66 mm
ACVM72-600	72 × 72 mm	0-600 V	1,5 %	66 mm
ACVM48-30	48 × 48 mm	0-30 V	1,5 %	42 mm
ACVM48-120	48 × 48 mm	0-120 V	1,5 %	42 mm
ACVM48-250	48 × 48 mm	0-250 V	1,5 %	42 mm
ACVM48-450	48 × 48 mm	0-500 V	1,5 %	42 mm
ACVM48-600	48 × 48 mm	0-600 V	1,5 %	42 mm

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

DC voltage meters

TRACON


DCVM96-30	96 × 96 mm	0-30 V	1,5 %	90 mm
DCVM96-120	96 × 96 mm	0-120 V	1,5 %	90 mm
DCVM96-250	96 × 96 mm	0-250 V	1,5 %	90 mm
DCVM96-400	96 × 96 mm	0-400 V	1,5 %	90 mm
DCVM96-600	96 × 96 mm	0-600 V	1,5 %	90 mm
DCVM72-30	72 × 72 mm	0-30 V	1,5 %	66 mm
DCVM72-120	72 × 72 mm	0-120 V	1,5 %	66 mm
DCVM72-250	72 × 72 mm	0-250 V	1,5 %	66 mm
DCVM72-400	72 × 72 mm	0-400 V	1,5 %	66 mm
DCVM72-600	72 × 72 mm	0-600 V	1,5 %	66 mm
DCVM48-30	48 × 48 mm	0-30 V	1,5 %	42 mm
DCVM48-120	48 × 48 mm	0-120 V	1,5 %	42 mm
DCVM48-250	48 × 48 mm	0-250 V	1,5 %	42 mm
DCVM48-400	48 × 48 mm	0-400 V	1,5 %	42 mm
DCVM48-600	48 × 48 mm	0-600 V	1,5 %	42 mm

RELEVANT STANDARD
EN 60051



L/O

Direct AC current meters




TRACON				
ACAM96-5	96 × 96 mm	0-5 A	1,5 %	90 mm
ACAM96-10	96 × 96 mm	0-10 A	1,5 %	90 mm
ACAM96-30	96 × 96 mm	0-30 A	1,5 %	90 mm
ACAM96-50	96 × 96 mm	0-50 A	1,5 %	90 mm
ACAM96-75	96 × 96 mm	0-75 A	1,5 %	90 mm
ACAM96-105	96 × 96 mm	0-100 A	1,5 %	90 mm
ACAM72-5	72 × 72 mm	0-5 A	1,5 %	66 mm
ACAM72-10	72 × 72 mm	0-10 A	1,5 %	66 mm
ACAM72-30	72 × 72 mm	0-30 A	1,5 %	66 mm
ACAM72-50	72 × 72 mm	0-50 A	1,5 %	66 mm
ACAM72-75	72 × 72 mm	0-75 A	1,5 %	66 mm
ACAM48-5	48 × 48 mm	0-5 A	1,5 %	42 mm


RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

These meters are eligible to measure the TRMS of the alternate current in 0-100 A current range without any other accessories. The measuring unit is an iron pointer. On the logarithmic scale the maximal elongation means twice as much as the metering range.

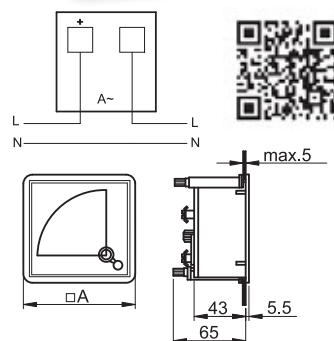

Direct DC current meters




TRACON				
DCAM96-0,02	96 × 96 mm	0-20 mA	1,5 %	90 mm
DCAM72-0,02	72 × 72 mm	0-20 mA	1,5 %	66 mm
DCAM48-0,02	48 × 48 mm	0-20 mA	1,5 %	42 mm

DC milliamper meters

TRACON				
DCAM96-5	96 × 96 mm	0-5 A	1,5 %	90 mm
DCAM96-20	96 × 96 mm	0-20 A	1,5 %	90 mm
DCAM72-5	72 × 72 mm	0-5 A	1,5 %	66 mm
DCAM72-20	72 × 72 mm	0-20 A	1,5 %	66 mm
DCAM48-5	48 × 48 mm	0-5 A	1,5 %	42 mm
DCAM48-20	48 × 48 mm	0-20 A	1,5 %	42 mm


RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010


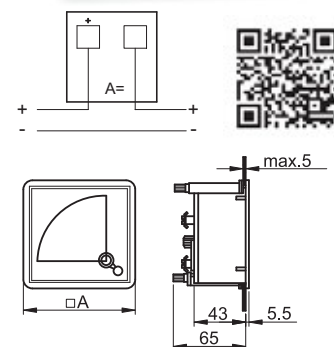


Indirect AC current meters with changeable dial plate

These meters are eligible to measure indirectly the current values of high current electric circuits. Suitable current transformers (CT) are used for extension of the measuring range. The basic instrument will be connected to the 5 A secondary coil of the CT. Changeable dial plates with 0 ... X metering range can be ordered according to the table below.


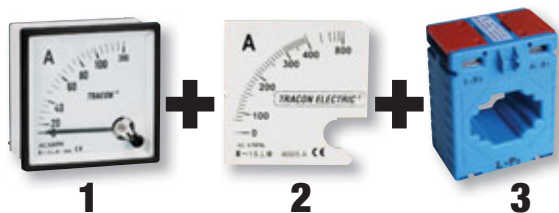


(1) Basic AC instruments



RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010



TRACON				
ACAM96-5	96 × 96 mm	0-5 A	1,5 %	90 mm
ACAM72-5	72 × 72 mm	0-5 A	1,5 %	66 mm
ACAM48-5	48 × 48 mm	0-5 A	1,5 %	42 mm

(2) Dial plates for ACAM... current meters



TRACON		
SCALE-AC96-X/5A	96 × 96 mm	0-X (A)
SCALE-AC72-X/5A	72 × 72 mm	0-X (A)
SCALE-AC48-X/5A	48 × 48 mm	0-X (A)

Please indicate the X value when ordering according to the desired measuring range.

(3) Harmonization table for current transformers and dial plates for indirect current metering



L/26


0-X	0-X	0-X	0-X	0-X	0-X	0-X	0-X
30/5	0-30 A	120/5	0-120 A	400/5	0-400 A	1500/5	0-1500 A
40/5	0-40 A	125/5	0-125 A	500/5	0-500 A	2000/5	0-2000 A
50/5	0-50 A	150/5	0-150 A	600/5	0-600 A	2500/5	0-2500 A
60/5	0-60 A	200/5	0-200 A	750/5	0-750 A	3000/5	0-3000 A
75/5	0-75 A	250/5	0-250 A	800/5	0-800 A	4000/5	0-4000 A
80/5	0-80 A	300/5	0-300 A	1000/5	0-1000 A	5000/5	0-5000 A
100/5	0-100 A						

Please remark the X value at ordering according to the wanted measuring range!


Indirect DC current meters with changeable dial plate




These meters are eligible to measure indirectly the current values of high current electric circuits. The extension of the metering range happens with shunt; the basic meter with 0 ... 75 mV voltage range has to be connected to the measuring contact of the shunt. For basic DC current meter a changeable dial plate can be ordered with 0-X metering range, according to the following table.

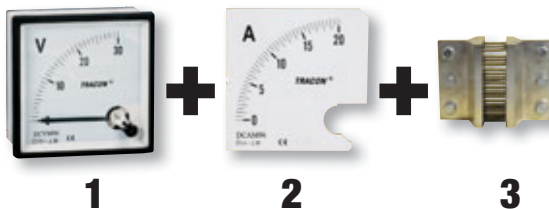

(1) DC basic meters




TRACON				
DCVM-96B	96 × 96 mm	0-75 mV	1,5 %	90 mm
DCVM-72B	72 × 72 mm	0-75 mV	1,5 %	66 mm
DCVM-48B	48 × 48 mm	0-75 mV	1,5 %	42 mm

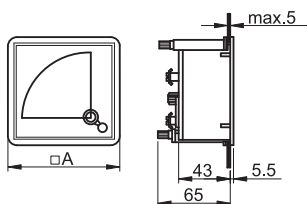

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010



(2) Dial plates for DC current metering

TRACON		
SCALE-DC96-X/75mV	96 × 96 mm	0-X (A)
SCALE-DC72-X/75mV	72 × 72 mm	0-X (A)
SCALE-DC48-X/75mV	48 × 48 mm	0-X (A)

Please remark the X value at ordering according to the wanted measuring range!



(3) Harmonization table for shunts and dial plates for indirect current metering

75mV	0-X	75mV	0-X	75mV	0-X
TSF-30	0-30 A	TSF-100	0-100 A	TSF-400	0-400 A
TSF-40	0-40 A	TSF-150	0-150 A	TSF-500	0-500 A
TSF-50	0-50 A	TSF-200	0-200 A	TSF-600	0-600 A
TSF-75	0-75 A	TSF-300	0-300 A	TSF-750	0-750 A
				TSF-1000	0-1000 A
				TSF-1500	0-1500 A
				TSF-2000	0-2000 A
				TSF-3000	0-3000 A

L/8

Please indicate the X value when ordering according to the desired measuring range.



Power meters


These power meters measure the active power of single or three phases loads. The metering range of the devices is determined according to the primary current (X) of the applied CT-s with 5 A secondary current. In panel meters of 96×96 mm frame size, the basic instrument and the plastic casing (box) of the measuring electronics are placed in the same unit, whereas with the meters of 72×72 mm frame size, the measuring electronics and the basic instrument are delivered separately and should be placed and wired separately in the control box as well. Dial plates can be done according to the table below.



(1) Power meters

	V1 UL94	 660 V	 IP 52	 IP 00	 Ta -25...+55°C	 0 20 40 - 0 lin	 1h in 1,2×In	 1h Un 1,2×Un	 1s In 4×In	 1s Un 2×Un	 kW
TRACON											
			U_n	I_n							
W96-400V/4	96 × 96 mm	0-100	400 V~	X/5 A	1,5 %	90 mm	× 3	L1, L2, L3, N			
W72-400V/4	72 × 72 mm	0-100	400 V~	X/5 A	1,5 %	66 mm	× 3	L1, L2, L3, N			

(2) Dial plates for power meters

	TRACON		
	L1, L2, L3, N		
	SCALE-W96/4-P	96 × 96 mm	0-P (kW)
	SCALE-W72/4-P	72 × 72 mm	0-P (kW)


Please always indicate the X and P data when ordering.

(3) Harmonization table for current transformers and dial plates for single or three phase power metering

	 3~		 3~		 3~
30/5	24 kW	125/5	100 kW	750/5	600 kW
40/5	32 kW	150/5	120 kW	800/5	640 kW
50/5	40 kW	200/5	160 kW	1000/5	800 kW
60/5	48 kW	250/5	200 kW	1500/5	1200 kW
75/5	60 kW	300/5	240 kW	2000/5	1600 kW
80/5	64 kW	400/5	320 kW	2500/5	2000 kW
100/5	80 kW	500/5	400 kW	4000/5	3200 kW
120/5	96 kW	600/5	480 kW	5000/5	4000 kW



L/26

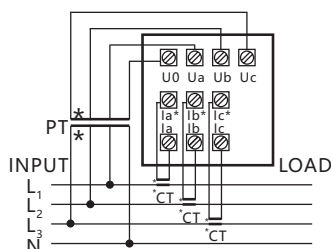


Legend

CT = current transformer





Frequency meters



TRACON				
F96-220/50	96 × 96 mm	45-55 Hz (230 V)	1,5 %	90 mm
F72-220/50	72 × 72 mm	45-55 Hz (230 V)	1,5 %	66 mm
F48-220/50	48 × 48 mm	45-65 Hz (230 V)	2,5 %	42 mm

Used to measure the frequency of low voltage networks, in the 45 ... 55 Hz range. Voltage has to be connected to the terminals of the device; the instrument displays the value of the frequency by help of a transformer enclosed within the unit.

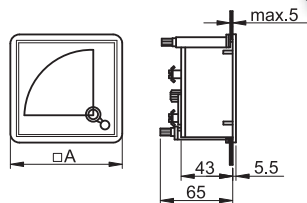

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

Power factor (cos φ) meters




TRACON			U_n	I_n		
CF96-0,5/1	96 × 96 mm	0,5 cap-1-0,5 ind	240 V~	X/5 A	1,5 %	90 mm
CF72-0,5/1	72 × 72 mm	0,5 cap-1-0,5 ind	240 V~	X/5 A	1,5 %	66 mm
CF96-0,5/3	96 × 96 mm	0,5 cap-1-0,5 ind	400 V~	X/5 A	2,5 %	90 mm
CF72-0,5/3	72 × 72 mm	0,5 cap-1-0,5 ind	400 V~	X/5 A	2,5 %	66 mm


These devices are measuring the power factor of single or three phases systems in 0,5 capacitive – 0,5 inductive range. If the current is higher than 5 A, a secondary current transformer of 5 A shall be used. According to capacitive or inductive load of the system, the pointer moves to the left (capacitive) or to the right (inductive) side on the symmetrical scale. The metering changer is installed in the housing.




Art of load
Lead = capacitive,
Lag = inductive



Wiring diagram for one phase system

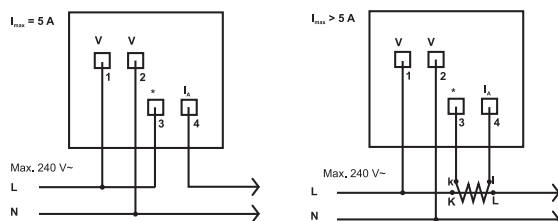

Wiring diagram for three phases system

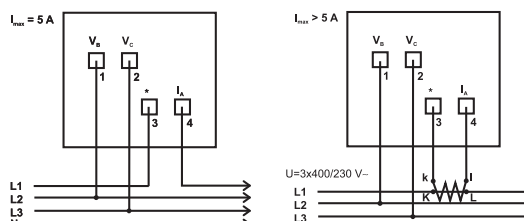


Operating time counters



Pictograms

L/O



TRACON

ISZ72-230	72 × 72 mm	66 mm
ISZ96-24	96 × 96 mm	90 mm
ISZ96-230	96 × 96 mm	90 mm



Displayed counting values cannot be reset!

Shunts


TRACON		L (mm)	C (mm)	B (mm)	H (mm)	M (mm)
TSF-30	30A/75mV	120	102	25	15	-
TSF-40	40A/75mV	120	102	25	15	-
TSF-50	50A/75mV	120	102	25	15	-
TSF-75	75A/75mV	110	86	23	10	M8 × 35
TSF-100	100A/75mV	106	86	23	10	M8 × 35
TSF-150	150A/75mV	116	86	21	22	M8 × 35
TSF-200	200A/75mV	116	86	21	22	M8 × 35
TSF-300	300A/75mV	127	100	26	22	M10 × 35

The voltage drop between the two connectors of the shunt - induced by the current, flowing through the shunt - is proportional to the resistance of the shunt. Therefore, the intensity of the current flowing through the circuit can be determined in function of the voltage measured between the end-points of the shunt with known resistance value. The diagram illustrates the process of voltage drop (U_m) in the shunt (R_s), measured with the instrument (mV). The current intensity value can be read directly on the dial scale in Ampere units.


The voltage drop between the measuring points of the available direct current shunts (TSF) is limited to max. 75 mV. Therefore, the measurement values of the attached basic instruments are also limited to 75 mV.

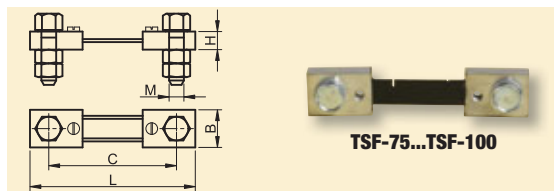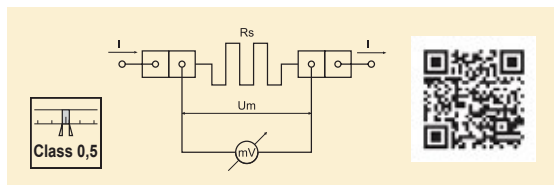


TSF-75...TSF-100

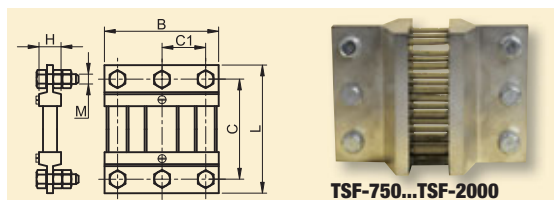


TSF-750...TSF-2000

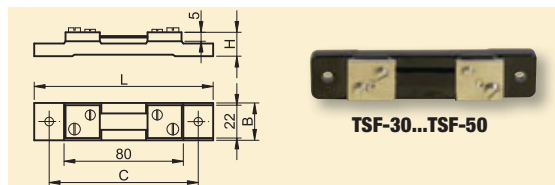

TSF-30...TSF-50

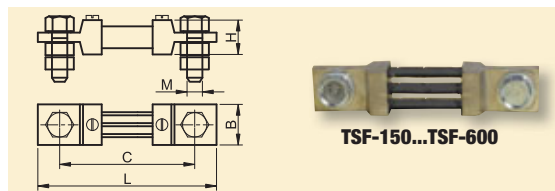


TSF-150...TSF-600


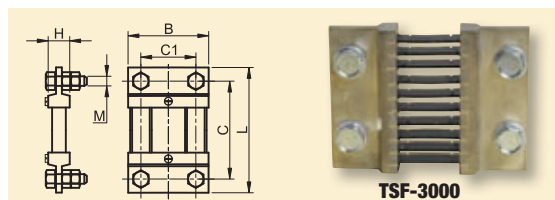


TSF-3000

Analogue voltage meters




TRACON			
ACVMS-25	V AC	0-25 V	1,5 %
ACVMS-100		0-100 V	1,5 %
ACVMS-450		0-450 V	1,5 %
DCVMS-100	V DC	0-100 V	1,5 %
DCVMS-250		0-250 V	1,5 %

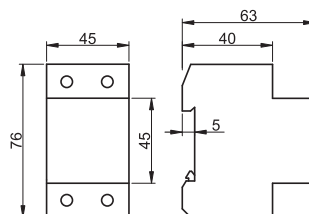

RELEVANT STANDARD
EN 60051



RELEVANT STANDARD
EN 61010

Analogue ampere-meters for direct measurement




TRACON			
DCAMS-20m*	V DC	0-20 mA	1,5 %

* The miliampere meters for direct current can be used to measure current values of electronic actuating and control circuits. For instrument, specific scales are also available after consulting our staff. In this way, the meter will be suitable to measure physical values after transforming it to electric values (e.g. temperature, rev).

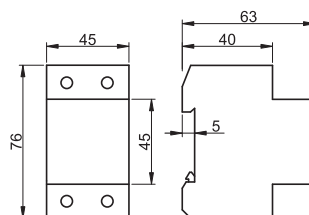


Analogue ampere-meters for indirect measurement, DC



(1) DC basic meters

TRACON			
DCVMS-X/75	0-X A	1,5 %	

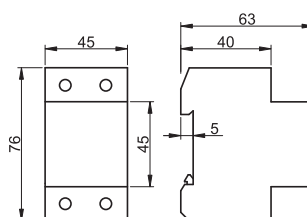

(2) Dial plates for DC current metering

TRACON			
SCALE-45 DC-X*	0-X (A)		

* Please indicate the X value when ordering according to the desired measuring range.

(3)



L/5

Analogue frequency meters




V1
UL94



Pictograms

L/O

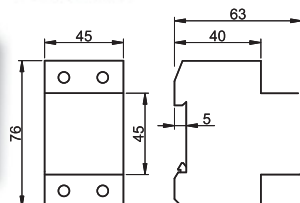

TRACON

F45S-230/50




45-55 Hz



1,0 %

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010



Power factor meters




V1
UL94



Pictograms

L/O

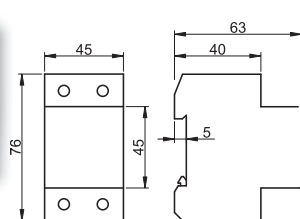



TRACON

CF45S-0,5/1

5 A/230 V 1f ±0,5 2,5 %

CF45S-0,5/3

5 A/400 V 3f ±0,5 2,5 %



Digital measuring instruments




V1
UL94



Pictograms

L/O

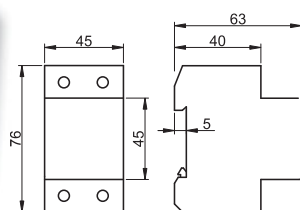

TRACON

ACAMSD-10



0-10 A



×3



1,5 %

ACVMSD-500





0-500 V



×3





1,5 %




Modular analogue power meters

These devices are metering the effective power of one or three phase systems. The metering range is determined by the primary voltage (X) of current transformers with 5 A secondary current. The actuating electronic is delivered independently from device and it have to be placed in the controlling box independently as well.

Scales can be ordered for the meters according to the attached table.

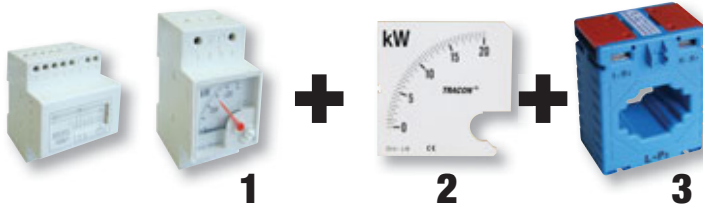

(1) Power meters



TRACON		U_n	I_n			
W45S-230/1	0-100	230 V~	X/5 A	1,5 %	×1	L1
W45S-400/4	0-100	400 V~	X/5 A	1,5 %	×3	L1, L2, L3, N

(2) Dial plates for power meters



TRACON			
L1	L1, L2, L3, N	0-P (kW)	1,5 %
SCALE-45 W/1-X	SCALE-45 W/4-X		

Please always indicate the X and P data when ordering.



(3) Harmonization table for current transformers and dial plates for single or three phase power metering

1~	3~	1~	3~	1~	3~	1~	3~	1~	3~	1~	3~	3~
30/5	7,5 kW	15 kW	120/5	30 kW	60 kW	400/5	100 kW	200 kW	1500/5	375 kW	750 kW	
40/5	10 kW	20 kW	125/5	31,25 kW	62,5 kW	500/5	125 kW	250 kW	2000/5	500 kW	1000 kW	
50/5	12,5 kW	25 kW	150/5	37,5 kW	75 kW	600/5	150 kW	300 kW	2500/5	625 kW	1250 kW	
60/5	15 kW	30 kW	200/5	50 kW	100 kW	750/5	187,5 kW	375 kW	3000/5	750 kW	1500 kW	
75/5	18,75 kW	37,5 kW	250/5	62,5 kW	125 kW	800/5	200 kW	400 kW	4000/5	1000 kW	2000 kW	
80/5	20 kW	40 kW	300/5	75 kW	150 kW	1000/5	250 kW	500 kW	5000/5	1250 kW	2500 kW	



L/26



SCAN THE QR CODE!

- Check our new products
- Be updated

Our range of products is continuously and quickly expanding. Our catalogue shows our products as of April 2019. Check our website to stay up-to-date.

Direct digital ammeter


230 V AC	ABS	V1 UL94	660 V	IP 40	IP 20	00878 (0,8-1,2)×Un	Ta -25...+65°C	A AC	Pictograms	L/O
----------	-----	---------	-------	-------	-------	--------------------	----------------	------	------------	-----

TRACON		 ×digit				C (mm)	D (mm)	
ACAMD-96-50	96 × 96 mm	×3	0-50 A AC	± 0,1 %	91 mm	67	8	445 g
ACAMD-72-50	72 × 72 mm	×3	0-50 A AC	± 0,1 %	68 mm	70	6	245 g



This device is able to directly measure current up to 50 A without any extra accessories. The pluggable terminals for power supply and metering are on the back side of the device. The output for current metering is one low-current transformer with 50/5A ratio also located at the back side of the device; the phase wire has to pass through the CT. The meters are operating fully automatically and a three digit display gives information from the measured value.

RELEVANT STANDARD EN 60051
RELEVANT STANDARD EN 61010

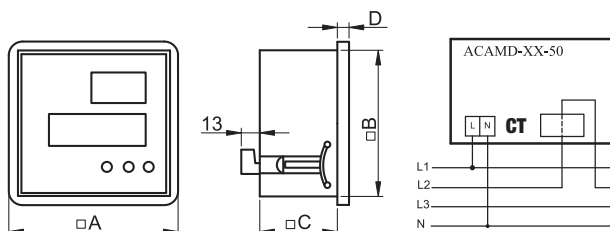

Digital ammeter with adjustable CT transfer ratio (with relay output)


230 V AC	ABS	V1 UL94	660 V	IP 40	IP 20	00878 (0,8-1,2)×Un	Ta -25...+65°C	AUX 1×CO	(mm²) 1-2,5	A AC
----------	-----	---------	-------	-------	-------	--------------------	----------------	----------	-------------	------

TRACON		 ×digit				C (mm)	D (mm)	
ACAMD-96	96×96 mm	×4	0-9500 A AC	± 2 %	91 mm	67	8	305 g
ACAMD-72	72×72 mm	×4	0-9500 A AC	± 2 %	68 mm	70	6	250 g
ACAMD-P-96*	96×96 mm	×4	0-9500 A AC	± 2 %	91 mm	67	8	320 g
ACAMD-P-72*	72×72 mm	×4	0-9500 A AC	± 2 %	68 mm	70	6	265 g

* Programmable relay output




L/26

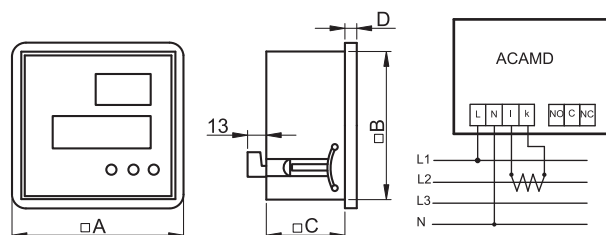

These meters are able to measure the effective value of alternate current, the CT-s transfer ratio is adjustable from 5/5 A to 10000/5 A. The device is programmable by front panel buttons. The microprocessor based programming enables the user to check the adjusted CT ratio, and define the critical current level for over-current alert via relay output. The ACAMD type meter is a version of ACAMD-P type without relay output.

Digital voltmeter (with phase-selection)







TRACON			U_n				C (mm)	D (mm)	
ACVMD-96-500	96 × 96 mm	×3	400 V~	0-500 V AC	± 1 %	91 mm	67	8	300 g
ACVMD-72-500	72 × 72 mm	×3	400 V~	0-500 V AC	± 1 %	68 mm	70	6	240 g
ACVMD-K-96-500*	96 × 96 mm	×3	400 V~	0-500 V AC	± 1 %	91 mm	67	8	305 g
ACVMD-K-72-500*	72 × 72 mm	×3	400 V~	0-500 V AC	± 1 %	68 mm	70	6	245 g

* The needed phase can be selected with a pushbutton on the device's front panel.


The ACVMD type instrument can measure the effective voltage value of three phases systems between 0 and 500 V. The connection terminals for the measured system and the power supply can be found in the back of the device. While measuring line voltage the measured phases have to be connected to the V1 and V2 terminals.

In case of phase voltage measuring the phase and neutral wires have to be connected to the V1 and V2 terminals.

At ACVMD-K type the measures phases have to be connected to L1, L2 and L3 terminals.






Digital ammeter and voltmeter with adjustable CT ratio



TRACON							C (mm)	D (mm)	
DTT-1-96	96×96 mm	×3/4	0-500 V AC	0-9500 A AC	± 1 %	91 mm	67	8	325 g
DTT-1-72	72×72 mm	×3/4	0-500 V AC	0-9500 A AC	± 1 %	68 mm	70	6	245 g

this microcontroller based device measures the connected line's current and voltage values. The current transformer (CT) ratio is adjustable from 5/5 A to 9500/5 A. The device measures the true effective (TRMS) values; the CT ratio is adjustable by front panel pushbuttons.

The pluggable terminals for power supply and metering are on the back side of the device. The voltage value is readable from the 3-digit display and the current value from the 4-digit LED one.



L/26



Digital frequency meter

230 V AC	ABS	V1 UL94	U _i 660 V	IP 40	IP 20	0.08-1.2 × U _n	Ta -25...+65°C	mm ² 1-2,5	Hz
-------------	-----	------------	-------------------------	-------	-------	---------------------------	-------------------	--------------------------	----


TRACON						C (mm)	D (mm)	
FD-96	96 × 96 mm	×3	45-75 Hz	± 1 %	91 mm	67	8	445 g
FD-72	72 × 72 mm	×3	45-75 Hz	± 1 %	68 mm	70	6	245 g



This sensitive and accurate microprocessor controlled meter is designed for metering the electric line's frequency. The measured value is readable from a 3 digits LED display. The pluggable terminals for power are on the back side of device.

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

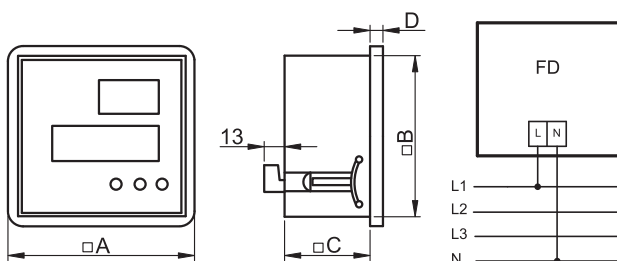

Digital power factor meter

230 V AC	ABS	V1 UL94	U _i 660 V	IP 40	IP 20	0.08-1.2 × U _n	Ta -25...+65°C	mm ² 1-2,5	cos φ
-------------	-----	------------	-------------------------	-------	-------	---------------------------	-------------------	--------------------------	-------


TRACON						C (mm)	D (mm)	
CFD-96	96×96 mm	×3	0,1-0,99	± 1 %	91 mm	67	8	305 g
CFD-72	72×72 mm	×3	0,1-0,99	± 1 %	68 mm	70	6	250 g




This is a smart microprocessor-controlled instrument used for measuring power factors in single- and three-phase lines. The measured value is readable from a 3 digits LED display. The pluggable terminals for power are on the back side of device. Front panels LED-s are giving information about power factor's status.



L/26

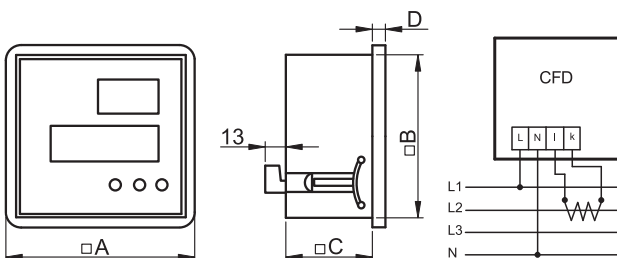

Digital multimeter






TRACON									
DTT-2	96 × 96 mm	×4	0-300 V AC	0-500 V AC	0-9500 A AC	40-99,9 Hz	± 1 %	92 mm	470 g
DTT-3*	96 × 96 mm	×4	0-300 V AC	0-500 V AC	0-9500 A AC	40-99,9 Hz	± 1 %	92 mm	515 g

* Programmable relay output

This microcontroller based device was designed to measure the true effective value (TRMS) of current and voltage in all three phases and the frequency of the system. The multimeter is able to store minimum and maximum values for both current and voltage, and is also capable to show these values to the user when desired.

The DTT-3 type has also programmable features for under and over voltage limits, under and over current limits and delay time before producing contact output. The DTT-2 type is similar to the DTT-3 type but without relay output. The DTT-3 type has two different contact outputs for current and voltage fault. The connection for power supply and metering is available through pluggable terminations on the back side of device.

The multimeter displays the momentary value of the current in all three phases and the frequency of the net. The line or phase voltage can be selected with the front panel pushbuttons and these momentary values are readable from the display. A LED lamp marks the selected phase. The current transformer (CT) ratio is also selectable with the front panel pushbuttons.

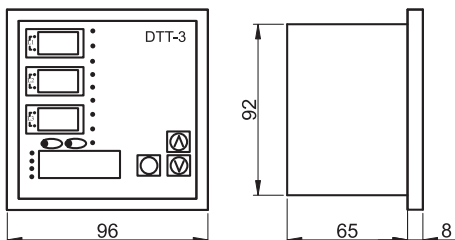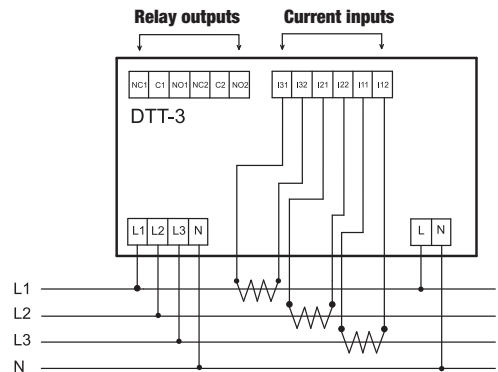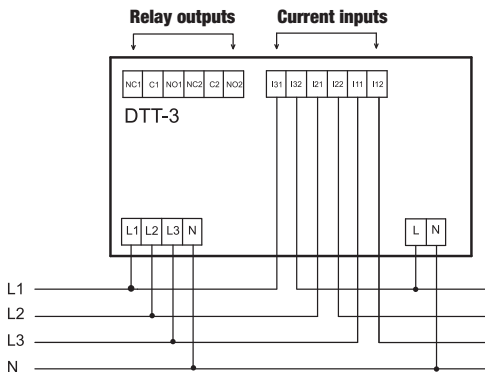


RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

L/26



DTT-5 detective multimeter




TRACON										
DTT-5	96 × 96 mm	×3	0-280 V AC	0-500 V AC	0-9500 A AC	45-70 Hz	± 0.1 %	92 mm	305 g	





RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010


This device can measure current and voltage values and frequency of line on three phase systems. The detective multimeter was designed to sense, detect and inform impending mechanical and electrical failures in three phase motors. Modern detective multimeter technology with the capability of fault detection at early stage provides excellently reliable system monitoring advantages, a remarkable productivity of quality production, minimized maintenance and repair costs and extended life of machinery and equipment in use. The measured min/max current values are saved in memory and can be displayed by request. Moreover the device features adjustable over/under current and voltage protection limits with adjustable time delay settings prior to producing contact output for alert. The multimeter compares the stored values with the momentary values and switches on the alarm levels gradually according to deviation. The alarm output is a potential free changeover relay contact output what can work by voltage or current failure. Programming of the relay output allows for definition of the alarm level at which the relay shall react in case of abnormal current or voltage. The connection for power supply and metering is available through pluggable terminations on the back side of device. The three digit LED displays are giving information from momentary metered values. A LED lamp signs the selected value. The current transformer (CT) ratio is also selectable with front panel pushbuttons.

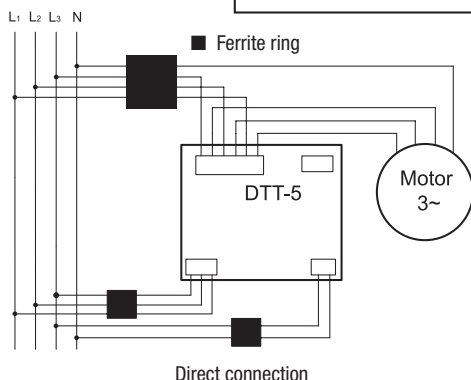

The terminal wires have to pass through ferrite rings as seen above in order to prevent electromagnetic disorder.

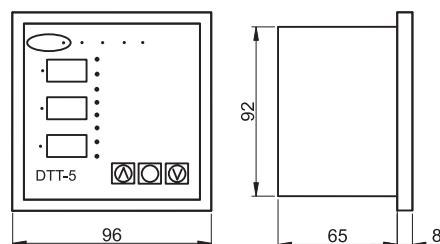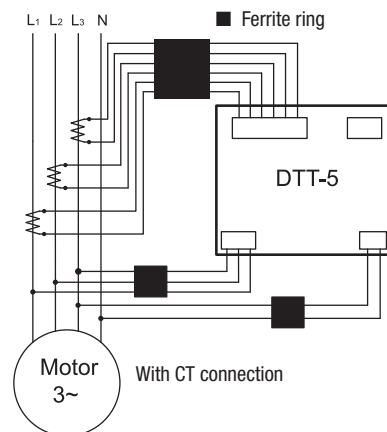

Power analyzer





TRACON										
DTT-4	96 × 96 mm	×3/7	0-280 V AC	0-500 V AC	0-9500 A AC	45-70 Hz	± 1 %	± 2 %	92 mm	500 g

This device is ideal for measuring, monitoring and controlling the network's electric parameters.


Furthermore, current, phase and line voltage frequency, power factor, real, apparent, reactive power and energy are measurable with the device which is also able to meter both current and voltage harmonics of network. The four LED displays show the needed values from 75 measurable parameters. The device meters the real effective values (TRMS), and has two potential free, independent programmable relay outputs, that change state by alarm according to user adjusted limits. A LED indicator marks the selected ones. The connection for power supply and metering is available through pluggable terminations on the back side of device. The current transformer (CT) ratio, the programming and the displayable value are all selectable with front panel push-buttons.

The operation of the device is fully automatic; its application is an advantage in all places where the energy supply control of the quality is important next to metering of the electric values.



RELEVANT STANDARD
EN 60051


RELEVANT STANDARD
EN 61010

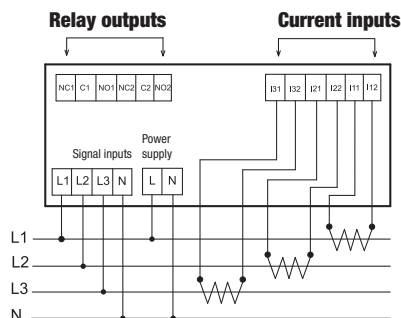

Remark	Measured value	Alarm	All	L1	L2	L3
VLN	Phase voltage (V)	✓	✓ (*)	✓	✓	✓
VLL	Line voltage (V)	✓	✓ (*)	✓	✓	✓
I	Phase current (A)	✓	✓	✓	✓	✓
FRQ	Frequency (Hz)	–	–	✓	–	–
PF	Power factor (cos φ)	–	✓ (*)	✓	✓	✓
kW	Real power (kW)	✓	✓	✓	✓	✓
kVAr	Reactive power (kVAr)	✓	✓	✓	✓	✓
kVA	Apparent power (kVA)	✓	✓	✓	✓	✓
kWh	Real energy (kWh)	–	✓	–	–	–
kVArh.IND	Inductive reactive energy (kVArh)	–	✓	–	–	–
kVArh.CAP	Capacitive reactive energy (kVArh)	–	✓	–	–	–
kVAh	Apparent energy (kVAh)	–	✓	–	–	–
V _{THD}	Total harmonics distortion of voltage (%)	–	–	✓	✓	✓
V _{3 ... V₁₃}	Voltage harmonics (THD; odd harmonics up to 13 th)	–	–	✓	✓	✓
I _{THD}	Total harmonics distortion of current (%)	–	–	✓	✓	✓
I _{3 ... I₁₃}	Current harmonics (THD; odd harmonics up to 13 th)	–	–	✓	✓	✓

* Device signs the mean value of metered values in three phases.

Direct energy meter




TRACON			U_n	I_b (I_{max})		imp/kWh S_0	$\frac{0}{10}$ ha %	$\frac{mm^2}{mm^2}$	$\frac{mm^2}{mm^2}$	$\frac{g}{g}$
TV0F11	DIRECT→kWh	LCD	230 V AC	5 (40) A	20 mA – 40 A	2.000	1	10	6	84 g
TV0F12	DIRECT→kWh	LCD	230 V AC	10 (60) A	40 mA – 60 A	500	1	25	16	157 g
TV0F14	DIRECT→kWh	LCD	230 V AC	10 (100) A	40 mA – 100 A	1.600	1	50	35	236 g
TV0F1M4	DIRECT→kWh	ELECTRO-MECHANICAL	230 V AC	10 (100) A	40 mA – 100 A	1.600	1	50	35	284 g
TV0F37	DIRECT→kWh	LCD	3×230/400 V AC	10 (100) A	40 mA – 100 A	400	1	50	35	455 g
TV0F3M7	DIRECT→kWh	ELECTRO-MECHANICAL	3×230/400 V AC	10 (100) A	40 mA – 100 A	400	1	50	35	472 g




TV0F11

TV0F12




TV0F11, TV0F12

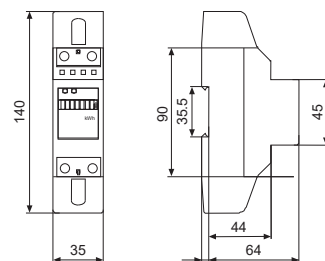


TV0F1M4

TV0F14




TV0F1M4, TV0F14

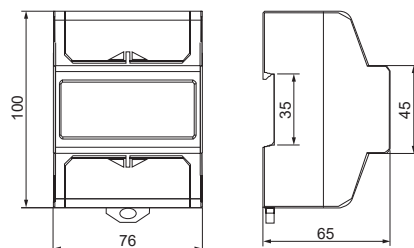


TV0F3M7

TV0F37



TV0F37, TV0F3M7

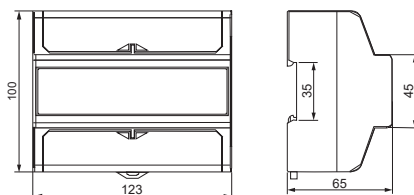


imp/kWh S_0	U_n	I_{lim}	I_n
	min. 12 V, max. 27 V	>30 ms	max. 27 mA

RELEVANT STANDARD
EN 62053


RELEVANT STANDARD
IEC 61036

Energy meters, 1 phase



TRACON		U _n	I _b (I _{max})		imp/kWh S0			
TVO-F1-CT	CT	220-240 V AC	5A/CT	0,002I _p -I _p	6.400	1	16 10	260 g

I_p – primary current of current transformer
CT – current transformer

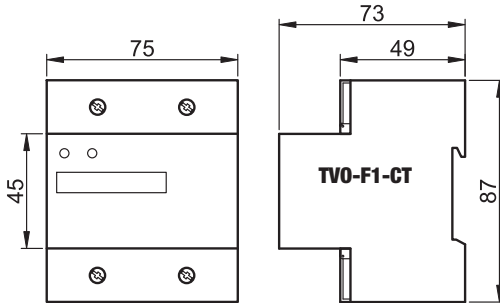


RELEVANT STANDARD
IEC 61036


RELEVANT STANDARD
EN 62053





imp/kWh S0	U _n	L _{imp}	I _n
	min. 18 V, max. 27 V	>30 ms	max. 27 mA

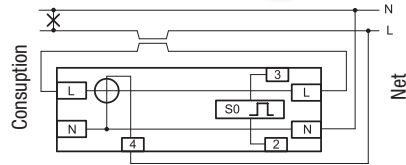

Power meter, windows type, 1 phase



TRACON		U _n	I _b (I _{max})		imp/kWh S0			
TVO-F1-WT	DIRECT	220-240 V AC	30 (100) A	80 mA-100 A	800	1	25 16	200 g

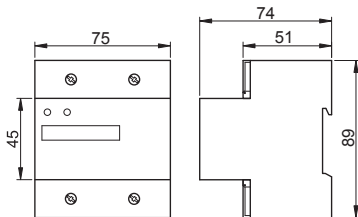


The wire must be put through the window, after that the screw make the contact with the insulation cutting. The reduction ring has been included for the thinner wires.



imp/kWh S0	U _n	L _{imp}	I _n
	min. 18 V, max. 27 V	>30 ms	max. 27 mA

RELEVANT STANDARD
IEC 61036






Energy meters, 3 phases


TRACON		U_n	I_b (I_{max})		imp/kWh S0 			
TV0-F3-4MCT CT  kWh 		3×230/400 V	5A/CT	0,002Ip-Ip	1.600	1	16 10	370 g
TV0-F3-4M DIRECT  kWh 		3×230/400 V	10 (100) A*	80 mA-100 A	200	2	25 16	450 g

* per phase

 Ip – primary current of current transformer
 CT – current transformer

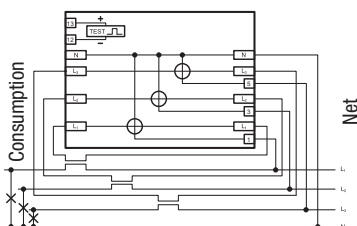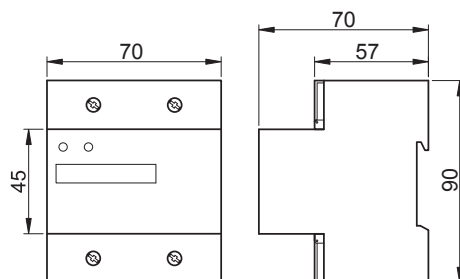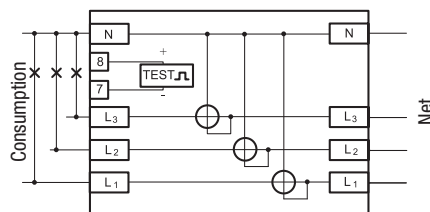TV0-F3-4MCT

RELEVANT STANDARD
IEC 61036
RELEVANT STANDARD
EN 62053

TV0-F3-4M

 imp/kWh
S0
 U_n


min. 18 V, max. 27 V

 I_{imp}

>30 ms

 I_n

max. 27 mA

Plug-in digital energy meter


TRACON	U_n	I_n		P_{max}		
TV0-1D216F DIRECT kWh LCD	230 V AC	16 A	2	3.600 W	3×357 A	200 g




The TV0-1D216.. type plug-in digital energy meter can display on its LCD the energy consumption in kWh and the energy costs of household or office devices plugged into its socket outlet.

Services:

- Overload-alarm (warning signal)
- Display of maximal value of current and power
- Display of operation time
- Clock
- Energy cost calculation


RELEVANT STANDARD
EN 62053

Phase corrector for three phase




TRACON								
TFJA-08	144 × 144 mm	4×20	18+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm	1030 g



RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

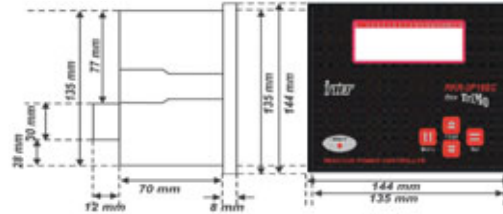

The hi-tech microprocessor based correctors with LCD display are suitable for setting 6×3 capacitor groups. These correctors are metering the parameters in one phase and the interference happens accordingly.


The power ratio value and style and the switched levels are displayed in automatic mode. In manual mode, the phase's current and voltage, the voltage harmonics, the active- reactive and blind power of network can also be measured and displayed; the user can control the number of capacitor groups too.

In automatic mode, the switching of capacitor groups takes place according to needed capacitor power and pre-adjusted parameters.

During rating process the switching of the levels follows a complex algorithm according to adjusted power factor value and level, protecting the capacitor groups and the switching contactors from run-down. The device has a potential free alarm output and it is programmable with its front panel pushbuttons.

Main functions

- 4 line LCD display, 20 digits / row
- Manual / automatic modes
- adjustable power ratio: $\cos\phi$ 0,8 ind - 0,8 cap
- Adjustable overheat protection
- Adjustable harmonic protection
- Voltage and current measurement up to 21st harmonic
- Alarms with alarm outputs
- Three phases, with phase control
- Automatic load type identification
- Delayed ON / OFF switching
- Adjustable overvoltage protection
- Total harmonic display
- Voltage, current and power display
- Password protection

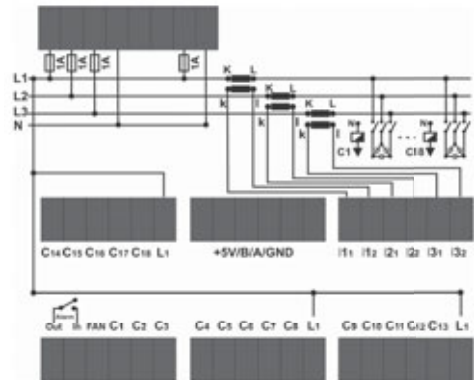

USB-485 converter for TFJA-08



TRACON		
TFJA-08-RS485	-25 °C ... +99 °C	90 g



Correctors for one phase



230 V AC	ABS	V0 UL94	Ui 660 V	IP 54	IP 20	LCD	Ta -25...+55°C	mm² 1-2,5	Pictograms	L/O
----------	-----	---------	----------	-------	-------	-----	----------------	-----------	------------	-----

TRACON								
--------	--	--	--	--	--	--	--	--

TFJA-01	144 × 144 mm	2×16	7+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm	1000 g
TFJA-02	144 × 144 mm	2×16	12+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm	1050 g



RELEVANT STANDARD EN 60051
RELEVANT STANDARD EN 61010




Hi-Tech, microprocessor based correctors with LCD display. They are suitable for setting 7 or 12 capacitor groups. These correctors are metering the parameters in one phase and the interference happens accordingly.

The value and the style of power ratio, the phase current and voltage, the voltage harmonics, the capacitor's temperature and the number of switched capacitor groups are displayable. On manual state the user can control the number of capacitor groups. During testing process the connected levels and the level's reactive power ratio is defined automatically. In automatic mode, the switching of capacitor groups takes place according to needed capacitor power and pre-adjusted parameters.


During rating process the switching of the levels follows a complex algorithm according to adjusted power factor value and level, protecting the capacitor groups and the switching contactors from run-down. The device has a potential free alarm output and it is programmable with front panel pushbuttons. The cooling is getting active according to pre-adjusted and memory stored level when the capacitor's temperature is rising up. The alarm output's active state is displayed by front panel LED.

Main functions


- adjustable power ratio ($\cos \varphi$) between 0,8 ind. – 1,0 cap;
- automatic and manual functions;
- exact initial capacitor power calculation;
- automatic current limit adjustment (C/k value);
- automatic polarity recognition on the CT terminals (k-l);
- adjustable overvoltage-overheat protection limit;
- alarm in case of over or under compensation;
- adjustable voltage-harmonics and overload protection limit;
- adjustable capacitor on and off switching time;
- power factor, phase voltage and current, frequency, temperature, voltage harmonics range metering, control, display;
- the art of failure and the switched number of levels also can be displayed.

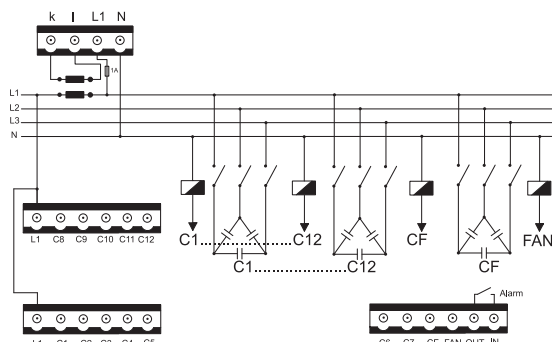

Correctors for three phases



TRACON							
TFJA-03	144 × 144 mm	2×16	7+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm 1030 g
TFJA-04	144 × 144 mm	2×16	12+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm 1030 g

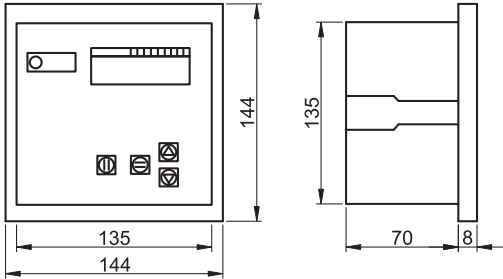

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010



Hi-Tech, microprocessor based correctors with LCD display. They are suitable for setting 7 or 12 capacitor groups. These correctors are metering the parameters in all three phase and the interference happens accordingly.

The metering of values is on analyzer level, the different levels capacitor power can be adjusted independent. In manual mode the user can control the number of capacitor groups. In automatic mode, the switching of capacitor groups takes place according to needed capacitor power and pre-adjusted parameters.


During rating process the switching of the levels follows a complex algorithm according to adjusted power factor value and level, protecting the capacitor groups and the switching contactors from run-down. The device has a potential free alarm output and it is programmable with front panel pushbuttons. The cooling is getting active according to pre-adjusted and memory stored level when the capacitor's temperature is rising up. The alarm output's active state is displayed by front panel LED.

Main functions

- Adjustable $\cos \varphi$ range between 0,8 ind. and 0,9 cap. values;
- Automatic / manual mode;
- Independent adjustable capacitor power limits;
- Automatic current detection;
- Adjustable over voltage and overheat limit;
- Adjustable high harmonic level;
- Adjustable capacitor switching delay;
- Adjustable total harmonic distortion voltage level (V_{THD} ; V_3 ; $V_5 \dots V_{13}$);
- Dimmable total harmonic distortion current level (I_{THD} ; I_3 ; $I_5 \dots I_{13}$);
- Capacitor test mode;
- Real, inductive, capacitive energy metering;

- Voltage, current, $\cos \varphi$, THD (total harmonic distortion) control on every phase;
- Capacitor power; temperature; frequency; total power factor control;
- Alarm in case of overvoltage, high temperature, high reactive and real energy rate, high harmonic ratio, with delay.

C/k adjustment: automatic, manual
 CT polarization: automatic
 A/D converter: 10 bit
 Sampling: 64 sample/period
 Contact / alarm output: 250 V/5 A AC

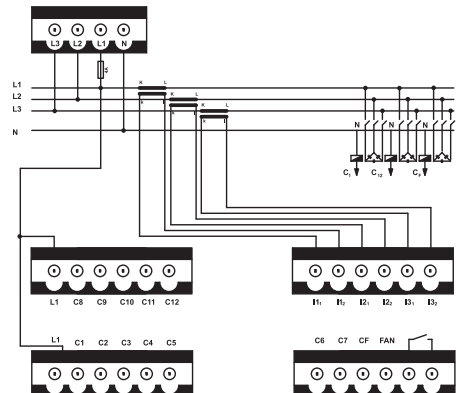


Automatic or manual correctors

230 V AC	ABS	V0 UL94	660 V	IP 54	IP 20	LCD		Ta -25...+55°C	[mm ²] 1-2,5	Pictograms	L/O
----------	-----	---------	-------	-------	-------	-----	--	----------------	--------------------------	------------	-----

TRACON		xdigit		*C	→lin			
--------	--	--------	--	----	------	--	--	--


TFJA-05	144 × 144 mm	3×7	5+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	92 mm	1000 g
TFJA-06	96 × 96 mm	3×7	7+1 (fix)	-25 °C ... +99 °C	0,02 A – 5,5 A	5/5 A...5000/5 A	135 mm	600 g

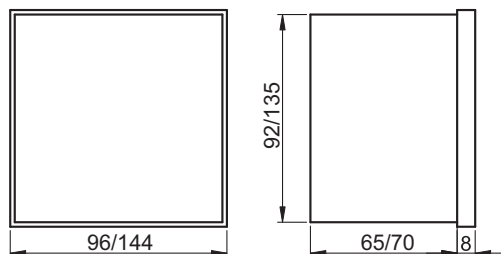

These devices are microprocessor based correctors with LCD display. They are suitable for setting 5 or 7 capacitor groups. These correctors are metering the parameters in one phase and the interference happens accordingly. The switching of capacitor groups is coordinated with the metered capacitor powers and the pre-adjusted full reactive power values. During rating process the switching of the levels follows a complex capacitor metering and power factor determine algorithm according to adjusted power factor value and level, protecting the capacitor groups and the switching contactors from run-down. The device has a potential free alarm output and it is programmable with front panel pushbuttons. The cooling is getting active according to pre-adjusted and memory stored level when the capacitor's temperature is rising up. The alarm output's active state is displayed by front panel LED.

Main functions

- Adjustable power ratio ($\cos \varphi$) from 0,8 to 1;
- Automatic and manual mode;
- Capacitor power metering;
- Automatic Ck adjustment;
- Automatic current flow definition;
- Dimmable capacitor on/off time;
- Display of phase voltage and power factor values;
- In case of alarming the displaying happens with LED.

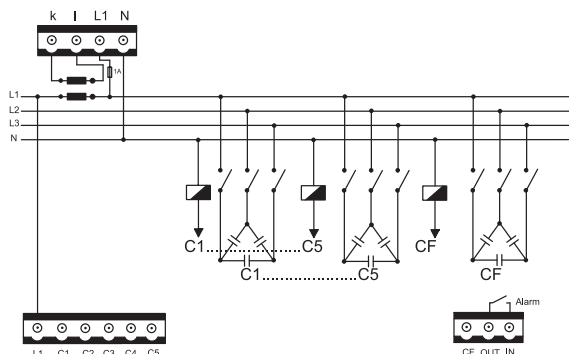

C/k adjustment: automatic
 CT polarization: automatic
 Contact output load: 250 V/5 A AC (TFJA-05), 250 V/3 A AC (TFJA-06)
 Alarm output load: 250 V/5 A AC (TFJA-05), 250 V/3 A AC (TFJA-06)

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010




SCAN THE QR CODE!

- Check our new products
- Be updated

Our range of products is continuously and quickly expanding. Our catalogue shows our products as of April 2019. Check our website to stay up-to-date.

Automatic operated correctors

230 V AC	ABS	V0 UL94	660 V	IP 30	IP 20	LCD	Ta -25...+55°C	(mm ²) 1-2,5	Pictograms	L/O
TRACON										
TFJA-07	144 × 144 mm	3×7	5	-25 °C ... +99 °C	5/5 A...5000/5 A	1 %	135 mm	1.200 g		

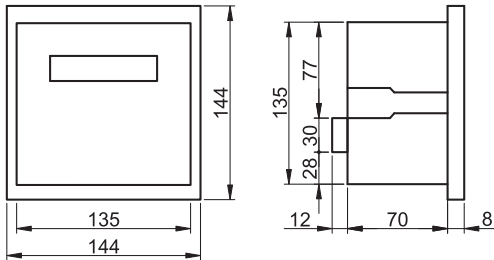


The TFJA-07 type reactive power corrector is fully automated and does not have any buttons on the front panel. The interference is happening according to the phase voltage and current in one phase. The device switches on the five capacitor groups in five steps by microcontroller based rating algorithm with contactors if the $\cos \varphi$ value is less than 0,95, and switches off the capacitors, when the $\cos \varphi$ value is more than 1. The switch on of capacitor groups happens in 14 seconds, the switch off happens with 5 seconds time delay. In load free or less load state, where $\cos \varphi$ value is not between 0,95 and 1, the first capacitor level works as a joker capacitor; it switches on/off the capacitors according to defined delay time. The lowest capacitor power group has to be connected to the first level. During the rating process the switching of the levels happens by a complex algorithm protecting the capacitor groups and the switching contactors from run-down. The power factor value is readable from the 3-digit front plate display. The front panel LED-s give information from the number of switched levels and the power ratio's style. The capacitor group's power and the distributions for levels can be made by the next table.

Capacitor outputs	1 st level	2 nd level	3 rd level	4 th level	5 th level
Capacitor power	1 - 1,5 kVar	2,5 kVar	5 kVar	10 kVar	20 kVar

Input of voltage meter: L1, N
 Sampling: 64 sample/period
 Input of current meter: k, l
 Max. load of current input: max. 7 A constant, 20 A / for 1 sec.
 Contact / alarm output: 250 V/5 A AC

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

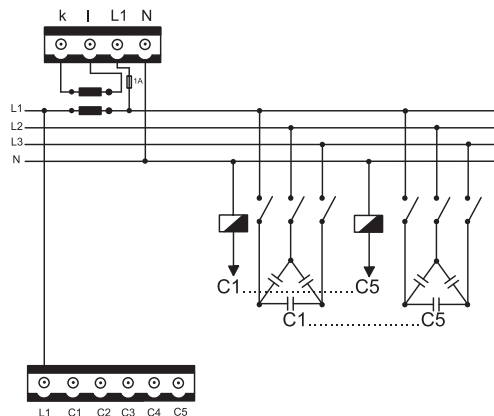

Low voltage current transformers

By using these devices, the measuring range of analogue or digital ammeters can be extended in the range of 5 - 3000 A. Similarly, the measuring range of the counters, power meters, multimeters, varmeters connected to the secondary contacts to the current transformers can also be extended.


Current transformers are made of a primary coil, a secondary coil and a ferromagnetic core. The primary coil is an actual coil built into the housing of the transformer or a cable or rail passing through the central hole of the transformer. In case of built-in primary coil or passed cable, the transformer has to be fixed by the kit delivered as accessory. In case of built in rail, the transformer shall be directly fastened to the rail.

The P1 end of the primary coil shall be connected to the network, the P2 end to the consumer. The S1 and S2 connectors shall be directly connected to the measuring instrument.



AVBS (5/5A-150/5A)

660 V AC	V0 UL94	U_i 720 V	U_{test} 1min 3 kV	F_s security 5	I_{th} 1,2×I _n	T_a -5...+45 °C	I_{th} 50×I _n	I_{din} 2,5×I _{th}	Pictograms	L/0
--------------------	-------------------	-------------------------------	---	---------------------------------------	---	-------------------------------------	--	---	-------------------	------------

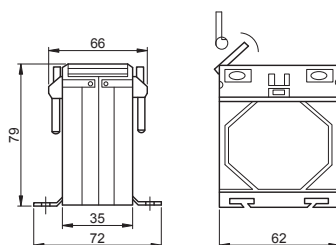


RELEVANT STANDARD
EN 61010

TRACON		P _s		
AVBS-5	5/5 A	2,5 VA	0,5	370 g
AVBS-15	15/5 A	2,5 VA	0,5	380 g
AVBS-30	30/5 A	2,5 VA	0,5	400 g
AVBS-50	50/5 A	2,5 VA	0,5	420 g
AVBS-60	60/5 A	2,5 VA	0,5	430 g
AVBS-75	75/5 A	2,5 VA	0,5	450 g
AVBS-100	100/5 A	2,5 VA	0,5	480 g
AVBS-150	150/5 A	2,5 VA	0,5	510 g

Type with built-in primary rail

AV30..SH (50/5A-200/5A)


660 V AC	V0 UL94	U_i 720 V	U_{test} 1min 3 kV	F_s security 5	I_{th} 1,2×I _n	T_a -5...+45 °C	I_{th} 100×I _n	I_{din} 2,5×I _{th}
--------------------	-------------------	-------------------------------	---	---------------------------------------	---	-------------------------------------	---	---

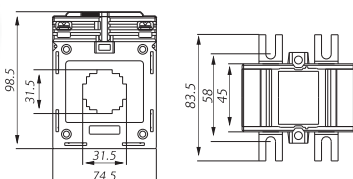

TRACON		P _s		
AV3060SH	60/5 A	1,5 VA	0,5	500 g
AV3075SH	75/5 A	2,5 VA	0,5	500 g
AV30100SH	100/5 A	3,75 VA	0,5	500 g
AV30150SH	150/5 A	5 VA	0,5	500 g
AV30200SH	200/5 A	5 VA	0,5	500 g

RELEVANT STANDARD
EN 60051




RELEVANT STANDARD
EN 61010



AV40..SH (100/5A-500/5A)

660 V AC	V0 UL94	 U_i 720 V		U_{test} 1min 3 kV	F_s security 5	 $1h$ $1,2 \times I_n$	T_a -5...+45 °C	I_{th} 50 $\times I_n$	I_{din} 2,5 $\times I_{th}$	 Pictograms	L/0
-------------	------------	--	---	----------------------------	------------------------	--	----------------------	-----------------------------	----------------------------------	--	-----




TRACON		P_s		
AV40100SH	100/5 A	2,5 VA	0,5	500 g
AV40150SH	150/5 A	5 VA	0,5	500 g
AV40200SH	200/5 A	5 VA	0,5	500 g
AV40250SH	250/5 A	5 VA	0,5	500 g
AV40300SH	300/5 A	5 VA	0,5	500 g
AV40400SH	400/5 A	5 VA	0,5	500 g
AV40500SH	500/5 A	5 VA	0,5	500 g



AV60..SH (600/5A-1200/5A)

660 V AC	V0 UL94	 U_i 720 V		U_{test} 1min 3 kV	F_s security 5	 $1h$ $1,2 \times I_n$	T_a -5...+45 °C	I_{th} max. 50kA _{eff}	I_{din} 2,5 $\times I_{th}$
-------------	------------	--	---	----------------------------	------------------------	--	----------------------	--------------------------------------	----------------------------------

TRACON		P_s		
AV60600SH	600/5 A	15 VA	0,5	450 g
AV60800SH	800/5 A	15 VA	0,5	480 g
AV601000SH	1000/5 A	15 VA	0,5	520 g
AV601200SH	1200/5 A	15 VA	0,5	520 g






RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

AV100..SH (1200/5A-3000/5A)

660 V AC	V0 UL94	 U_i 720 V		U_{test} 1min 3 kV	F_s security 5	 $1h$ $1,2 \times I_n$	T_a -5...+45 °C	I_{th} max. 50kA _{eff}	I_{din} 2,5 $\times I_{th}$
-------------	------------	--	---	----------------------------	------------------------	--	----------------------	--------------------------------------	----------------------------------

TRACON		P_s		
AV1001200SH	1200/5 A	15 VA	0,5	690 g
AV1001600SH	1600/5 A	15 VA	0,5	850 g
AV1002000SH	2000/5 A	15 VA	0,5	1.000 g
AV1002500SH	2500/5 A	15 VA	0,5	1.050 g
AV1003000SH	3000/5 A	15 VA	0,5	1.200 g




RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

Calibrated current transformer

These current transformers are fulfilling the requirements of EN 60044-1 standard and meeting the requirements of 0,5S accuracy class.

if the user wants to use them for account measuring, the current transformers have to be calibrated by the National Trade Licensing Office.


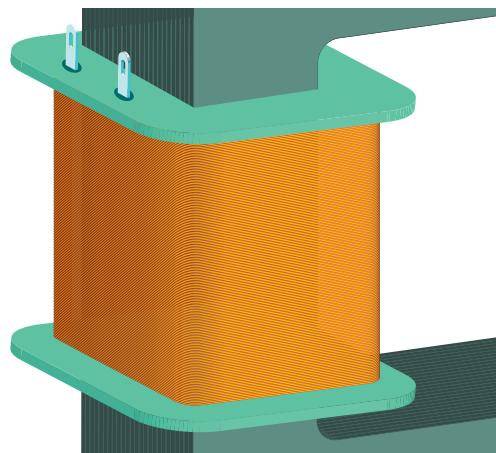


RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

EPSA30 (150/5A-400/5A) 1,5 VA

660 V AC	MKEH -MH	U_i 720 V		U_{test} 1min 3 kV	F_s security 5	t_{1h} $1,2 \times I_n$	T_a -5...+45 °C	I_{th} $60 \times I_n$	I_{din} $2,5 \times I_{th}$	Pictograms	L/0
-------------	-------------	----------------	--	----------------------------	------------------------	---------------------------	----------------------	-----------------------------	----------------------------------	------------	------------



TRACON



P_s





TRACON		P_s	$0.5S$	m
EPSA30150-1,5	150/5 A	1,5 VA	0,5S	300 g
EPSA30200-1,5	200/5 A	1,5 VA	0,5S	300 g
EPSA30250-1,5	250/5 A	1,5 VA	0,5S	300 g
EPSA30300-1,5	300/5 A	1,5 VA	0,5S	300 g
EPSA30400-1,5	400/5 A	1,5 VA	0,5S	300 g

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010

EPSA30 (150/5A-500/5A) 2,5 VA

660 V AC	MKEH -MH	U_i 720 V		U_{test} 1min 3 kV	F_s security 5	t_{1h} $1,2 \times I_n$	T_a -5...+45 °C	I_{th} $60 \times I_n$	I_{din} $2,5 \times I_{th}$
-------------	-------------	----------------	--	----------------------------	------------------------	---------------------------	----------------------	-----------------------------	----------------------------------



TRACON



P_s



TRACON		P_s	$0.5S$	m
EPSA30150-2,5	150/5 A	2,5 VA	0,5S	300 g
EPSA30200-2,5	200/5 A	2,5 VA	0,5S	300 g
EPSA30250-2,5	250/5 A	2,5 VA	0,5S	300 g
EPSA30300-2,5	300/5 A	2,5 VA	0,5S	300 g
EPSA30400-2,5	400/5 A	2,5 VA	0,5S	300 g
EPSA30500-2,5	500/5 A	2,5 VA	0,5S	300 g

RELEVANT STANDARD
EN 60051

RELEVANT STANDARD
EN 61010


EPSA30 (150/5A-500/5A) 2,5 VA

660 V AC	MKEH -MH	 U_i 720 V		U_{test} 1min 3 kV	F_s security 5	 $1,2 \times I_n$ In	T_a -5...+45 °C	I_{th} 60 $\times I_n$	I_{din} 2,5 $\times I_{th}$	 Pictograms	L/O
-------------	-------------	--	---	----------------------------	------------------------	--	----------------------	-----------------------------	----------------------------------	--	-----

TRACON		P_s		
EPSA30150-5	150/5 A	5 VA	0,5S	300 g
EPSA30200-5	200/5 A	5 VA	0,5S	300 g
EPSA30250-5	250/5 A	5 VA	0,5S	300 g
EPSA30300-5	300/5 A	5 VA	0,5S	300 g
EPSA30400-5	400/5 A	5 VA	0,5S	300 g
EPSA30500-5	500/5 A	5 VA	0,5S	300 g

RELEVANT STANDARD
EN 60051


RELEVANT STANDARD
EN 61010

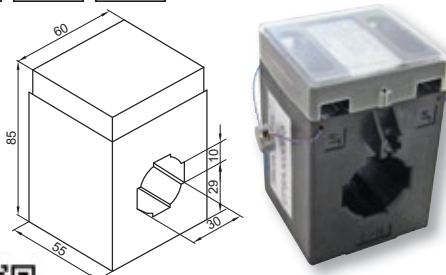

EPSA40 (250/5A-500/5A) 2,5-5 VA

660 V AC	MKEH -MH	 U_i 720 V		U_{test} 1min 3 kV	F_s security 5	 $1,2 \times I_n$ In	T_a -5...+45 °C	I_{th} 60 $\times I_n$	I_{din} 2,5 $\times I_{th}$
-------------	-------------	--	---	----------------------------	------------------------	--	----------------------	-----------------------------	----------------------------------

TRACON		P_s		
EPSA40250-2,5	250/5 A	2,5 VA	0,5S	300 g
EPSA40300-2,5	300/5 A	2,5 VA	0,5S	300 g
EPSA40400-2,5	400/5 A	2,5 VA	0,5S	300 g
EPSA40500-2,5	500/5 A	2,5 VA	0,5S	300 g
EPSA40250-5	250/5 A	5 VA	0,5S	300 g
EPSA40300-5	300/5 A	5 VA	0,5S	300 g
EPSA40400-5	400/5 A	5 VA	0,5S	300 g
EPSA40500-5	500/5 A	5 VA	0,5S	300 g

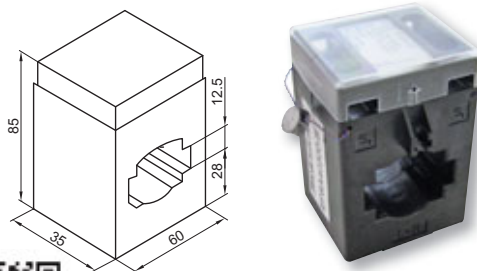

Wireless door bell



F/43

Digital multimeter

T_o

0-40 °C

low batt

CAT

III

G

200mA

Pictograms

L/0

TRACON

xdigit

V

I

Ω

batt

115×65×35 mm

170 g



Backlight



RELEVANT STANDARD
EN 61010

DC V test	200 mV, 2 V, 20 V, 200 V, 500 V
AC V test	200 V, 500 V
DC A test	200 μA, 2 mA, 20 mA, 200 mA, 10 A
Ω test	200 Ω, 2 kΩ, 20 kΩ, 200 kΩ, 20 MΩ
test	3 V / 1 mA
G	3 V / 50 Hz / 560 kΩ

Digital clamp meter for A880L device

T_o

0-40 °C

AC A test

DC A test

TRACON

I

batt

186×73×40 mm

350 g




The EM264 digital clamp meter is an auxiliary device for digital multimeters to measure AC/DC current without breaking the measured wire.

DC A test	40-400 A
AC A test	40-400 A
40 A	10 mV/A
400 A	1 mV/A

Function buttons
DC ZERO zero adjust at DC measuring
IKON Measuring range selector

Digital multimeter



TRACON	00876 xdigit	0 10 ha %	0 10 ha %	0 10 ha %	batt	L H W	m
HK36A	× 3.5	±(2%+10d)	±(3%+5d)	±(1,5%+2d)	9 V, 6F22	150×75×50 mm	270 g

Backlight

DC V test	200 mV, 2 V, 20 V, 200 V, 500 V
AC V test	200 V, 500 V
DC A test	200 µA, 2 mA, 20 mA, 200 mA, 10 A
Ω test	200 Ω, 2 kΩ, 20 kΩ, 200 kΩ, 20 MΩ
test	2,5 V / 1 mA
G	5 V / 50 Hz / 560 kΩ



RELEVANT STANDARD
EN 61010



EMERGENCY LIGHTS

- **3-8 W**
- **Maintaned and no-maintaned modes**
- **1-3 h bridging time, Ni-Cd battery**
- **Surface and recessed types**
- **Variable beam angle**

E1/52-E1/53

Digital clamp meter

+ VS-

0...+40 °C

low batt

AC V test

DC V test

AC A test

Ω test

test

Pictograms

L/O

TRACON

x digit

V

I

Ω

1,5 V, 3×AAA

132×61×25 mm

170 g

EM306B

× 3,5

±(1,5%+5d)

±(2,5%+5d)

±(2,0%+5d)



DC V test	600 V
AC V test	600 V
AC A test	20 - 200 A
Ω test	200Ω - 2kΩ - 20kΩ - 200kΩ - 2MΩ - 20MΩ
test	1,5 V; 0,6 mA

RELEVANT STANDARD
EN 61010

Function buttons
HOLD Holding the momentary value

Digital clamp meter

+ VS-

0...+40 °C

low batt

test

AC V test

DC V test

AC A test

Ω test

Pictograms

L/O

TRACON

x digit

V

I

Ω

°C

9 V, 1×6LA61

240×90×40 mm

320 g

LF266

× 3,5

±(2%+5d)

±(2,5%+5d)

±(1,2%+5d)

–



DC V test	1000 V
AC V test	750 V
AC A test	200-1000 A
Ω test	0,2-20 kΩ

RELEVANT STANDARD
EN 61010

Function buttons
HOLD Holding the momentary value

Tool to follow wires

TRACON				
EM422A	1,5 V, 2×AAA	3 V, 4×LR44	151×65×34 mm	127 g

This tool is suitable to follow non active wires. It has two parts, a transmitter and a receiver. In case of ideal circumstances it can sense in 30 cm range. This range depends on the ambient circumstances like insulation, other wires etc.

Transmitter

The transmitter has five adaptors to connect to the wire

- RJ-11 connector
- Koax connector
- Double crocodile clip
- Automotive fuse connector

The adaptors can be found under the front plate

Receiver

To activate the receiver please push and hold the **TEST** button so the receiver senses the signal of transmitter. Move the device towards the wire to sense. If the wire is continuous a ton signal appears and the light of **LED** increases. The sensitivity of receiver can be adjusted with the **Sensitivity button**.

Ta 
0...+40 °C


LED



RELEVANT STANDARD
EN 61010

Infrared thermometer

TRACON					
HM-01	9 V, 1×6F22	-20 °C ... +320 °C	-4 °F ... +608 °F	45×155×90 mm	150 g

- Temperature measurement without contact, °C/°F switchover
- Spot laser beam for precise positioning
- Clearly visible LCD display with blue background lighting
- Warning for low battery
- Data- Hold function; carrying bag



RELEVANT STANDARD
EN 61010

Motor vehicle testing lamp

TRACON			
FV-06	–	118 × 11 × 11 mm	30 g
FV24	–	3 × 135 mm	45 g

DC V test	6-24 V
-----------	--------

RELEVANT STANDARD
EN 61010



Operation time: max. 10 sec



Voltage tester screwdriver



RELEVANT STANDARD
EN 61010



Pictograms

L/0

TRACON



FK

–

190 × 18,5 × 18,5 mm

28 g

AC V
test

100-400 V

Voltage tester



Function buttons

ON-OFF button
Light



Pictograms

L/0

TRACON



GK6A

1,5 V, 2 × AAA

153 × 36 × 24 mm

70 g

AC V
test

100-1000 V

Induction voltage tester



RELEVANT STANDARD
EN 61010



Pictograms

L/0

TRACON



FV-01

–

130 × 18 × 15 mm

15 g

DC V
test

12-36-55-110-230 V

AC V
test

12-36-55-110-230 V

Bathroom fan family



F/45

VF...



VFM...




VFG100



VFS100

Terminal blocks

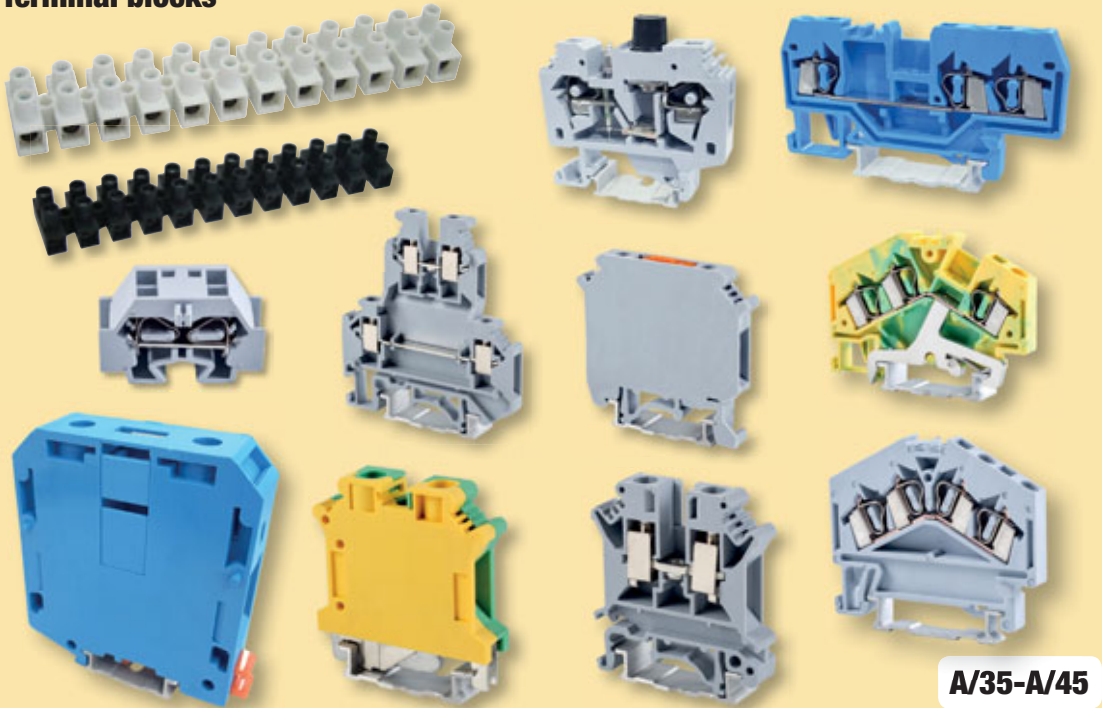

A/35-A/45

TRACON
.....ELECTRIC®

Our webshop renewed!



- **New design**
- **Optimized view for mobile applications**
- **Expanded product data sheets**
- **Own developed search engine**
- **Property filters**
- **Faster and more clear shopping**
- **Comparative module**

www.traconelectric.com